

support for rail mounting
DIN EN 60715




CT/CTS/CTE/CTSE inserts coupling screws
cable-clamping plates




description	part No.	part No.
supports for CT, CTS, CTE, CTSE inserts	CT APE	CRBF CRBM
bush for CT, CTS, CTE, CTSE inserts screw pin for CN, CD, CNE, CCE, CSE inserts		CRAD CRAS
straight cable clamping plate angled cable clamping plate		

Coupling screws for CT/CTE inserts


The use of CRBF (female) and CRBM (male) coupling screws is recommended to guarantee a stable and safe coupling between inserts (without enclosures) with terminal blocks and inserts without terminal blocks.

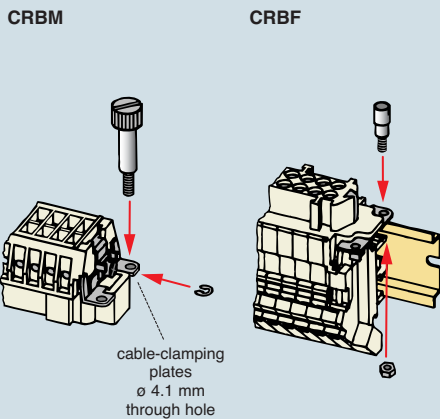


dimensions in mm

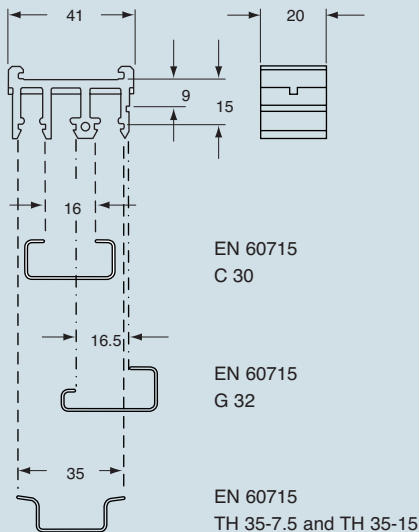


dimensions in mm

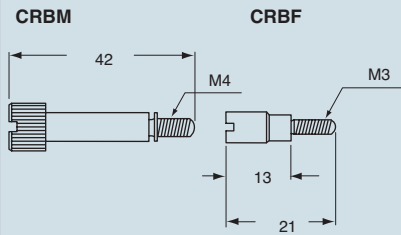

CRAD

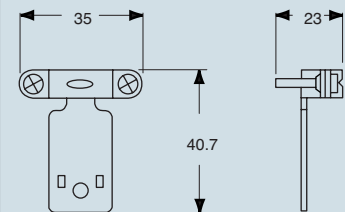


CRAS

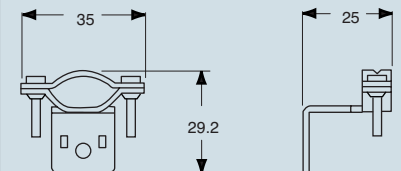

Note: for conductor groups or cable with Ø min = 12 mm and Ø max = 23 mm

Use of cable-clamping plates

In accordance with the recommendations of standard IEC 60352-2, the weight of the conductor groups or multipolar cables must not cause any stress on the contacts inside the inserts. It is therefore advisable to use cable-clamping plates in those inserts without enclosures

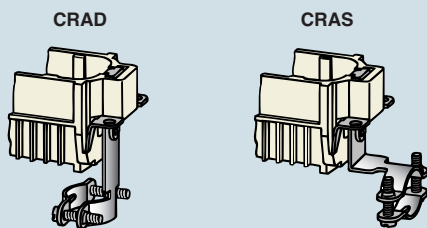

dimensions indicated are not binding and may be changed without notice